

VALVE

LOCATED 300mm INSIDE PROPERTY BOUNDARY (or TERMINATED ALONGSIDE EXIST. GATE VALVE IN METER BOX FOR MAIN REPLACEMENT). ALL VALVES SHALL BE FEMALE\FEMALE.

PIPE 20 O.D. FOR FRONT LOT CONNECTION & 25 O.D. FOR REAR LOT R.O.W. CONNECTION.


PUSHLOK MALE ADAPTOR IF REQUIRED.

MILNES TAPPING BAND TAPPED 25ø (20ø N.B.), TP63 PUSHLOK RANGE, FOR USE WITH PE PIPE OR PE TAPPING TEES.

RIDER OR PRINCIPAL MAIN


NOTE:

1. This solution is not acceptable in concrete, sealed or areas with vehicle traffic. (Refer SD6.12.5 for suitable construction details based on these sizing requirements).
2. In-line or one-sided arrangements acceptable to suit site conditions
3. Meters are to be nested to save space.
4. Permanently numbered tags to be provided on each connection (Unit 1 or lowest unit number on LHS).

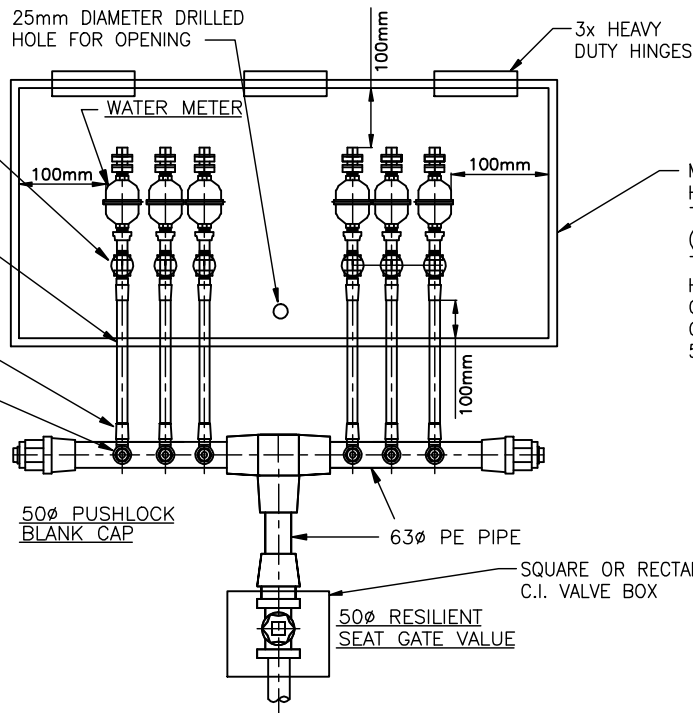

MANIFOLD ASSEMBLY FOR SIX TO TWELVE WATER CONNECTIONS

N.T.S.

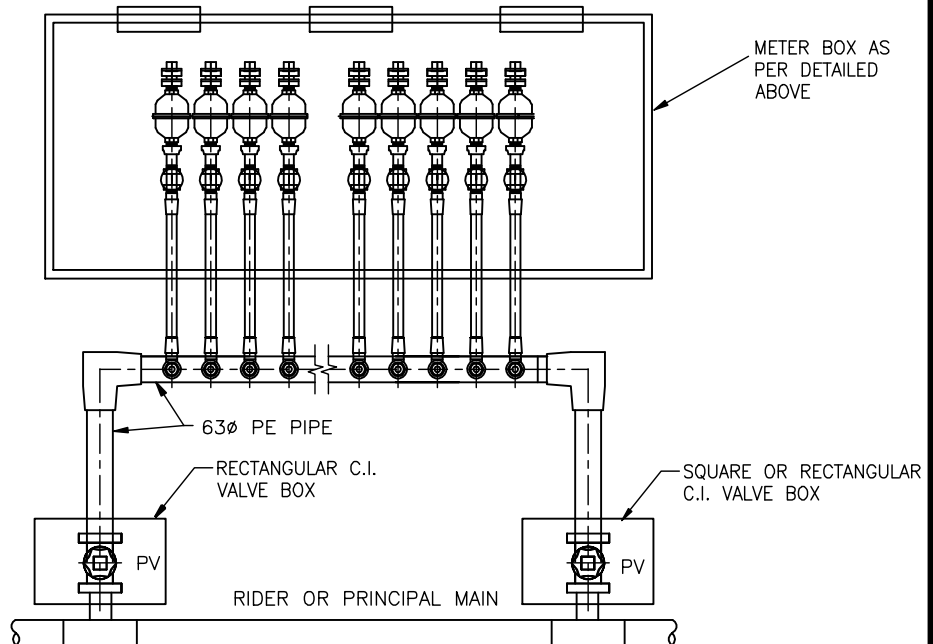

RING ARRANGEMENT FOR THIRTEEN TO TWENTY METERS

N.T.S.